MONITORING LIVE ELECTRICAL EQUIPMENT AT HIGH OR MEDIUM VOLTAGE

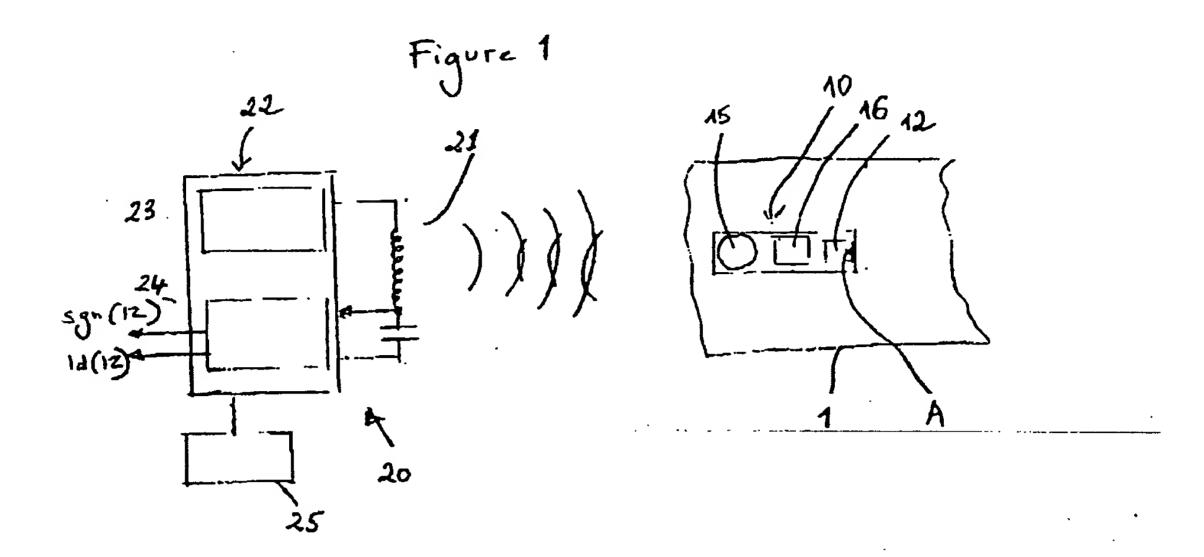


Figure 2

